



# AIR FILTER TESTING LABORATORIES, INC.

4632 OLD LA GRANGE ROAD | CRESTWOOD, KENTUCKY 40014 PHONE (502) 222-6720

## ASHRAE TEST STANDARD 52.1-1992 AIR FILTER PERFORMANCE CURVES


REPORT NO. 9498

TEST NO. 1


SHEET NO. 2

STATICALLY  
TESTED  
DEVICES

### CLEAN DEVICE AIRFLOW -VS- RESISTANCE

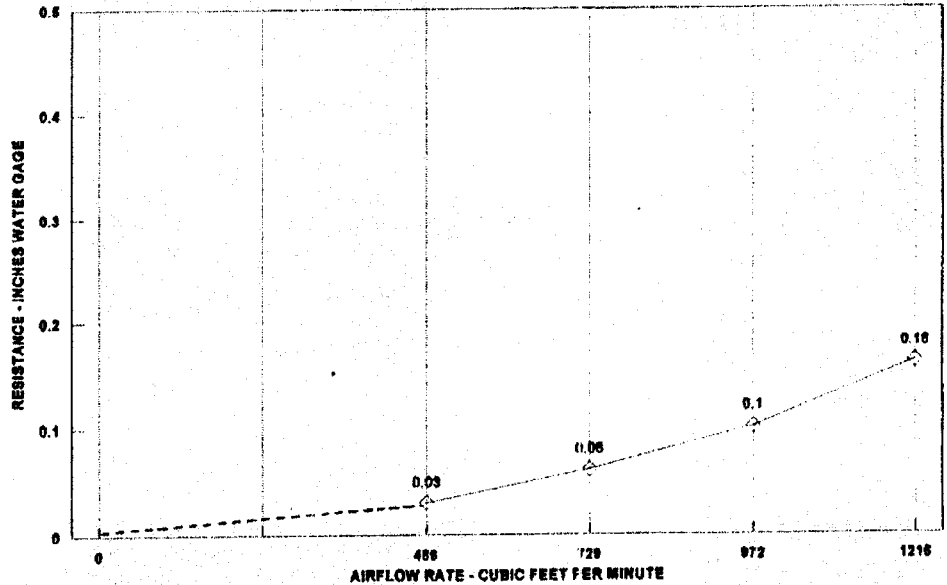

### DUST FED -VS- RESISTANCE DUST INCREMENT - 80 GRAINS ASHRAE

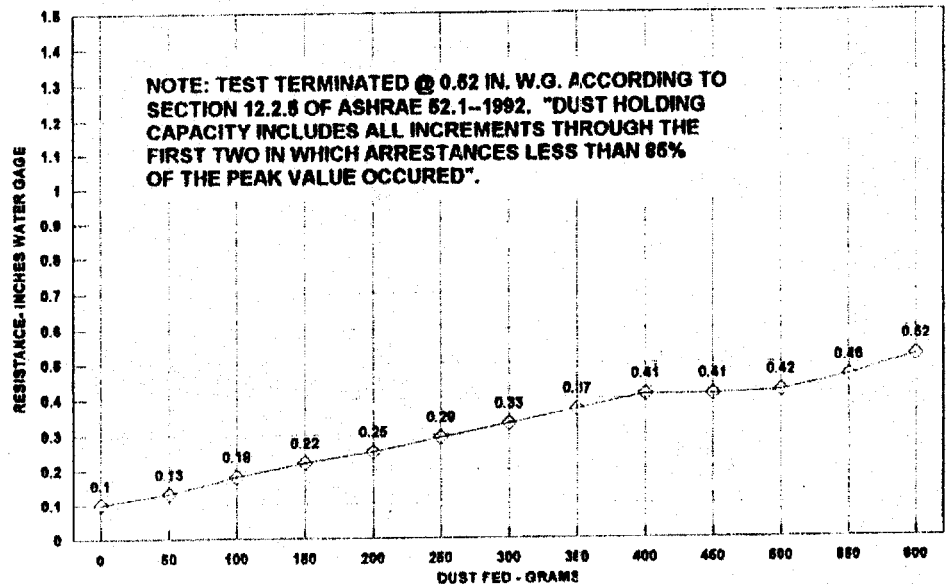

DATE

8-5-1996

TEST SUPERVISOR

J.P.S.

ENGINEERING  
APPROVAL

*David J. Murphy, Jr.*

